



CERTIFICATION VERIFICATION



SELECT CODE
NAME2

December 4, 2024

Tanks Data LLC
613 Pine Lake Ave
Laporte, IN 46350

Testing Date: 12/4/2024
Phillips 66
Location of Test: 613 Pine Lake Ave
Laporte, IN 46350
Site FID#: 16239
Service Technician:
Certified Technician: ADAM WILDER

0

Midwest ECS has completed the following tests/inspections at the above noted location:

Cathodic Protection - sacrificial	X
Cathodic Protection - impressed current	

I, ADAM WILDER, the certified technician, was present throughout the duration of the testing and/or inspection performed by Midwest ECS at the above address on the above date. I affirm that the testing was done in accordance with Rule 329 IAC 9 and 40CFR Part 80, is accurate based upon the results received and that these forms accurately reflect the results of the testing and/or inspection.


Technician Signature: _____

Technician Printed Name: _____

ADAM WILDER

Date & Time: _____

12/4/2024

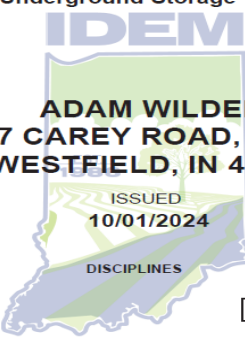INDIANA DEPARTMENT OF ENVIRONMENTAL MANAGEMENT		
Underground Storage Tank		
		
ADAM WILDER 17437 CAREY ROAD, BOX 163 WESTFIELD, IN 46074		
STATE/PERMIT# UC112310	ISSUED 10/01/2024	EFFECTIVE 10/01/2024
DISCIPLINES		
☒ Installation or Retrofitting Expiration Date: 1/23/2025	☐ Decommissioning Expiration Date:	☐ Tank Tightness Testing Expiration Date:
☒ Cathodic Protection Expiration Date: 8/8/2026		



CATHODIC PROTECTION



TEST DATE: 12/4/2024
LOCATION NAME: Phillips 66
LOCATION ADDRESS: 613 Pine Lake Ave
LOCATION CITY/STATE: Laporte, IN 46350
LOCATION PHONE: 317-645-0215
LOCATION CONTACT: Virendar Kumar


OWNER NAME: Tanks Data LLC
OWNER ADDRESS: 613 Pine Lake Ave
OWNER CITY/STATE/ZIP: Laporte, IN 46350
LOCATION FID#: 16239
WORK ORDER NO: NE-1492

SYSTEM TYPE: GALVANIC
TEMPERATURE: 24*
CONDITIONS: WINDY
TIME: 8:00AM

TANK NO		1	2	3	4		
PRODUCT STORED		RUL	MID	PUL	DSL		
TANK CAPACITY		12000	8000	6000	2000		
TANK SIZE		96"	96"	96"	64"		
TANK CONTACT		TB	TB	TB	TB		
REFERENCE CELL LOCATION	LOCAL	TM	TM	TM	TM		
VOLTAGE READING		-856	-865	-979	-862		
REFERENCE CELL LOCATION	LOCAL	STP	STP	STP	VAPOR		
VOLTAGE READING		-854	-889	-974	-875		
REMOTE VOLTAGE		-851	-922	-995	-852		
RESULT		PASS	PASS	PASS	PASS		

LEGEND	
TW	TEST WIRE
TB	TANK BOTTOM
TM	TANK MONITORING PROBE OPENING
INT	INTERSTITIAL OPENING

SITE DIAGRAM

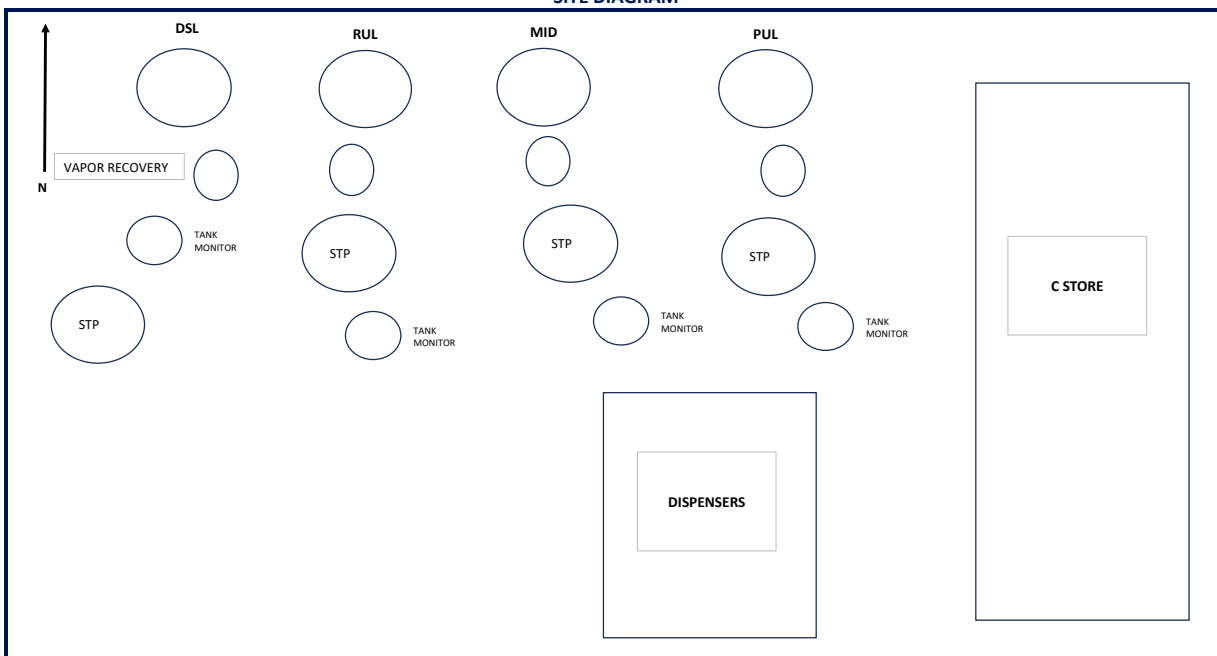

ADAM WILDER
CERTIFIED TECHNICIAN NAME
(printed)

CERTIFIED TECHNICIAN SIGNATURE

CERT NO: UC112310
EXPIRATION DATE: 8/8/2026