



UST TESTING/INSPECTION RESULTS SUMMARY

OWNER NAME: New Punjab LLC
ADDRESS: 29026 State Road 20
CITY/STATE/ZIP: Elkhart, IN 46517

TESTING DATE: 10/10/2023

LOCATION NAME: Midwest Petro
LOCATION ADDRESS: 29026 State Road 20
LOCATION CITY/STATE: Elkhart, IN 46517
LOCATION FID#: 25595

THREE YEAR TESTS/INSPECTIONS

SPILL BUCKET INTERGRITY TESTING

COMPLETED

TANK NO	PRODUCT	CONSTRUCTION	RESULT
1	RUL	Double Walled	PASS
2	PUL	Double Walled	PASS
3	DSL	Double Walled	PASS
4	KER	Double Walled	PASS

HYDROSTATIC SUMP TEST

COMPLETED

SUMP ID	MATERIAL	DEPTH	HYDROSTATIC RESULT	VISUAL RESULT
RUL STP	POLY	36"	PASS	PASS
PUL STP	POLY	36"	FAIL	PASS
DSL STP	POLY	36"	PASS	PASS
KER STP	POLY	36"	PASS	PASS
DISP 1/2	POLY	32"	PASS	PASS
DISP 3/4	POLY	32"	PASS	PASS
DISP 5/6	POLY	13.75"	PASS	PASS
DISP 7/8	POLY	17.5"	PASS	PASS
KER DISP	POLY	13.5"	PASS	PASS

OVERFILL EQUIPMENT INSPECTION

COMPLETED

TANK	PRODUCT	TYPE	BALL FLOAT RESULT	AUTO SHUT OFF RESULT
1	RUL	Automatic Shutoff Valve		PASS
2	PUL	Automatic Shutoff Valve		PASS
3	DSL	Automatic Shutoff Valve		PASS
4	KER	Automatic Shutoff Valve		PASS

OVERFILL ALARM TEST

NOT PERFORMED

TANK	PRODUCT	BRAND/MODEL	RESULT

LEGEND:

RUL	Regular Unleaded
DSL	Diesel
PUL	Premium Unleaded
KER	Kerosene
ODSL	Off Road Diesel
REC	Recreational

RECOMMENDATIONS:

SITE PHOTOS

TEST DATE: 10/10/2023
LOCATION NAME: Midwest Petro
LOCATION ADDRESS: 29026 State Road 20
LOCATION CITY/STATE: Elkhart, IN 46517
LOCATION PHONE: 317-645-0215
LOCATION CONTACT: Tanks Data / Virendar Kumar

OWNER NAME: New Punjab LLC
OWNER ADDRESS: 29026 State Road 20
OWNER CITY/STATE/ZIP: Elkhart, IN 46517
LOCATION FID#: 25595
WORK ORDER NO: NE-0761

SITE VIEW



DSL OVERFILL EQUIP TEST



RUL OVERFILL EQUIP TEST



KER OVERFILL EQUIP TEST



SITE PHOTOS

TEST DATE: 10/10/2023

LOCATION NAME: Midwest Petro

LOCATION ADDRESS: 29026 State Road 20

LOCATION CITY/STATE: Elkhart, IN 46517

LOCATION PHONE: 317-645-0215

LOCATION CONTACT: Tanks Data / Virendar Kumar

OWNER NAME: New Punjab LLC

OWNER ADDRESS: 29026 State Road 20

OWNER CITY/STATE/ZIP: Elkhart, IN 46517

LOCATION FID#: 25595

WORK ORDER NO: NE-0761

PUL OVERFILL EQUIP TEST



INTENTIONALLY LEFT BLANK

RUL STP SUMP TEST START 15"



RUL STP SUMP TEST END 15"



SITE PHOTOS

TEST DATE: 10/10/2023
LOCATION NAME: Midwest Petro
LOCATION ADDRESS: 29026 State Road 20
LOCATION CITY/STATE: Elkhart, IN 46517
LOCATION PHONE: 317-645-0215
LOCATION CONTACT: Tanks Data / Virendar Kumar

OWNER NAME: New Punjab LLC
OWNER ADDRESS: 29026 State Road 20
OWNER CITY/STATE/ZIP: Elkhart, IN 46517
LOCATION FID#: 25595
WORK ORDER NO: NE-0761

DSL STP SUMP TEST START 17.75"



DSL STP SUMP TEST END 17.75"



KER STP SUMP TEST START 20"



KER STP SUMP TEST END 20"



SITE PHOTOS

TEST DATE: 10/10/2023
LOCATION NAME: Midwest Petro
LOCATION ADDRESS: 29026 State Road 20
LOCATION CITY/STATE: Elkhart, IN 46517
LOCATION PHONE: 317-645-0215
LOCATION CONTACT: Tanks Data / Virendar Kumar

OWNER NAME: New Punjab LLC
OWNER ADDRESS: 29026 State Road 20
OWNER CITY/STATE/ZIP: Elkhart, IN 46517
LOCATION FID#: 25595
WORK ORDER NO: NE-0761

PUL STP SUMP TEST START 16"



PUL STP SUMP TEST END 14"



DISP 1/2 SUMP TEST START 16"



DISP 1/2 SUMP TEST END 16"




SITE PHOTOS

TEST DATE: 10/10/2023
LOCATION NAME: Midwest Petro
LOCATION ADDRESS: 29026 State Road 20
LOCATION CITY/STATE: Elkhart, IN 46517
LOCATION PHONE: 317-645-0215
LOCATION CONTACT: Tanks Data / Virendar Kumar

OWNER NAME: New Punjab LLC
OWNER ADDRESS: 29026 State Road 20
OWNER CITY/STATE/ZIP: Elkhart, IN 46517
LOCATION FID#: 25595
WORK ORDER NO: NE-0761

DISP 3/4 SUMP TEST START 13"

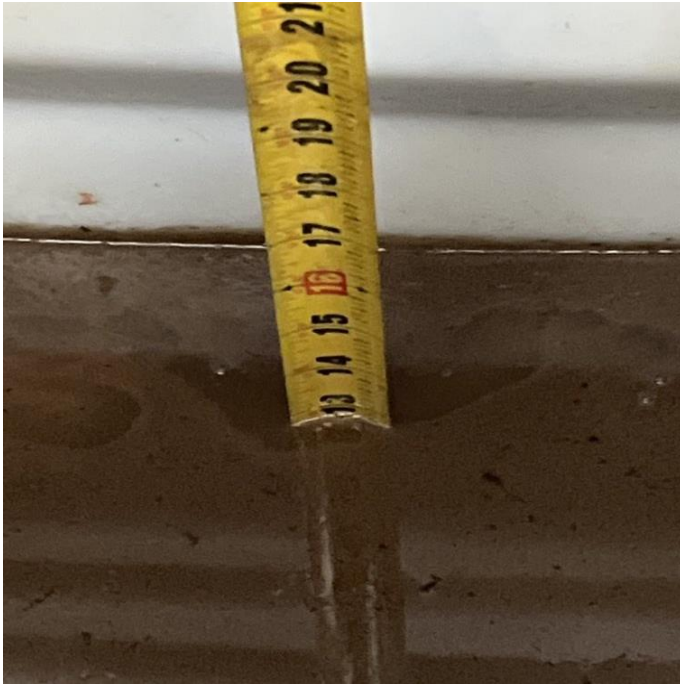


DISP 3/4 SUMP TEST END 13"



DISP 5/6 SUMP TEST START 13.75"



DISP 5/6 SUMP TEST END 13.75"

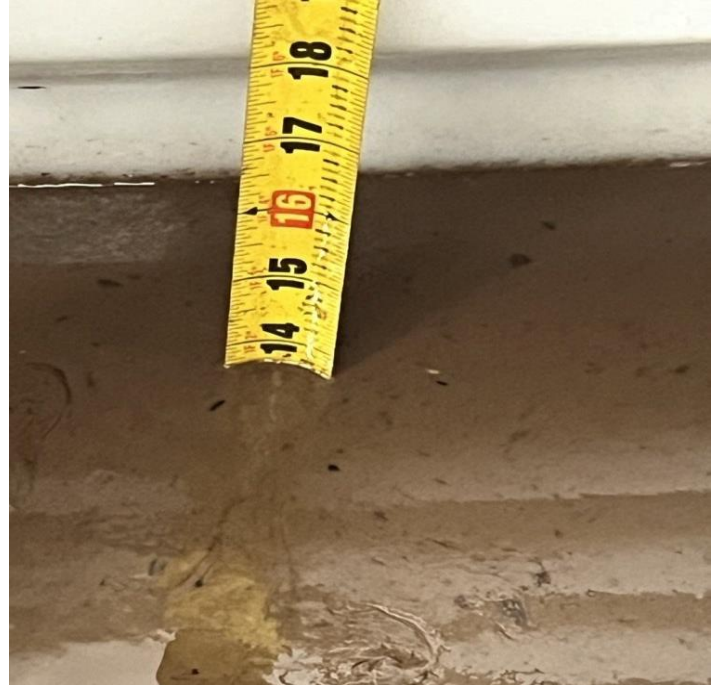


SITE PHOTOS

TEST DATE: 10/10/2023
LOCATION NAME: Midwest Petro
LOCATION ADDRESS: 29026 State Road 20
LOCATION CITY/STATE: Elkhart, IN 46517
LOCATION PHONE: 317-645-0215
LOCATION CONTACT: Tanks Data / Virendar Kumar

OWNER NAME: New Punjab LLC
OWNER ADDRESS: 29026 State Road 20
OWNER CITY/STATE/ZIP: Elkhart, IN 46517
LOCATION FID#: 25595
WORK ORDER NO: NE-0761

DISP 7/8 SUMP TEST START 17.5"

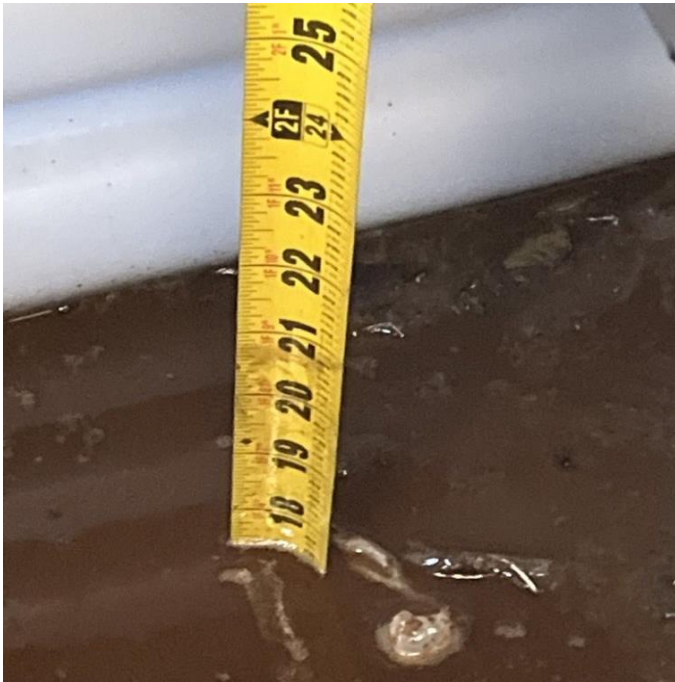

DISP 7/8 SUMP TEST END 17.5"



RUL SPILL BUCKET TEST START 13"



RUL SPILL BUCKET TEST END 13"



SITE PHOTOS

TEST DATE: 10/10/2023
LOCATION NAME: Midwest Petro
LOCATION ADDRESS: 29026 State Road 20
LOCATION CITY/STATE: Elkhart, IN 46517
LOCATION PHONE: 317-645-0215
LOCATION CONTACT: Tanks Data / Virendar Kumar

OWNER NAME: New Punjab LLC
OWNER ADDRESS: 29026 State Road 20
OWNER CITY/STATE/ZIP: Elkhart, IN 46517
LOCATION FID#: 25595
WORK ORDER NO: NE-0761

PUL SPILL BUCKET TEST START 13"



PUL SPILL BUCKET TEST END 13"



DSL SPILL BUCKET TEST START 15"



DSL SPILL BUCKET TEST END 15"



SITE PHOTOS

TEST DATE: 10/10/2023
LOCATION NAME: Midwest Petro
LOCATION ADDRESS: 29026 State Road 20
LOCATION CITY/STATE: Elkhart, IN 46517
LOCATION PHONE: 317-645-0215
LOCATION CONTACT: Tanks Data / Virendar Kumar

OWNER NAME: New Punjab LLC
OWNER ADDRESS: 29026 State Road 20
OWNER CITY/STATE/ZIP: Elkhart, IN 46517
LOCATION FID#: 25595
WORK ORDER NO: NE-0761

KER SPILL BUCKET TEST START 14.5"



KER SPILL BUCKET TEST END 14.5"





CERTIFICATION VERIFICATION

New Punjab LLC
29026 State Road 20
Elkhart, IN 46517

Testing Date: 10/10/2023
Midwest Petro
Location of Test: 29026 State Road 20
Elkhart, IN 46517
Site FID#: 25595
Service Technician:
Certified Technician: ADAM WILDER

0

Midwest ECS has completed the following tests/inspections at the above noted location:

ATG Functionality	
Leak Detector	
Elec Line Leak Detector	
Product Line Testing	
Liquid Sensor Functionality	
Spill Bucket	X
Containment Hydrostatic Sump	X
Overfill Equipment Inspection	X
Overfill Alarm	
Vent Valve	
Interstitial	
Non-Volumetric Tank Tightness	
Shear Valve Inspection	

I, ADAM WILDER, the certified technician, was present throughout the duration of the testing and/or inspection performed by Midwest ECS at the above address on the above date. I affirm that the testing was done in accordance with Rule 329 IAC 9 and 40CFR Part 80, is accurate based upon the results received and that these forms accurately reflects the results of the testing and/or inspection.

Technician Signature: _____

Technician Printed Name: _____ ADAM WILDER

Date & Time: 10/10/2023 @ 10:00AM

	INDIANA HOMELAND SECURITY			
	Underground Storage Tank			
ADAM P WILDER 500 SIMS STREET FRANKFORT, INDIANA				
STATE/PERMIT # UC112310	ISSUE 01/30/2023	EFFECTIVE 01/30/2023	EXPIRATION 01/23/2025	
DISCIPLINES				
☒ Installation or Retrofitting	☐ Decommissioning Closure			
☐ Cathodic Protection	☐ Decommissioning Removal			
☐ Testing				

I attest with my signature below, that this technician was present onsite for testing as described above.