



CATHODIC PROTECTION - IMPRESSED CURRENT
SOIL TO STRUCTURE/POLARIZATION DECAY



TEST DATE: 6/16/2025
LOCATION NAME: State Road 23 Property LLC
LOCATION ADDRESS: 59572 Mayflower Road
LOCATION CITY/STATE: South Bend, IN 46614
LOCATION PHONE: 0
LOCATION CONTACT: 0

OWNER NAME: Tanks Data LLC
OWNER ADDRESS: 59572 Mayflower Road
OWNER CITY/STATE/ZIP: South Bend, IN 46614
LOCATION FID#: 14301
WORK ORDER NO: PASS #249632

RECTIFIER MANUFACTURER: TANKNOLGY
MODEL: GCAI
SERIAL NO: 162606

VOLTS 60 AMPS 3.3
DC OUTPUT: 60
COURSE: N/A
FINE: N/A


CONTACT POINT	REFERENCE CELL LOCATION	VOLTAGE CURRENT ON	INSTANT OFF VOLTAGE	FINAL VOLTAGE	VOLTAGE DECAY	RESULT
TANK NO:	1	PRODUCT STORED: RUL	TANK CAPACITY: 10000			
TB	FILL	1220	1039			PASS
TB	TM	1204	871			PASS
TB	STP	1059	896			PASS
TANK NO:	2	PRODUCT STORED: PLUS	TANK CAPACITY: 6000			
TB	FILL	963	857			PASS
TB	TM	958	868			PASS
TB	STP	1000	878			PASS
TANK NO:	3	PRODUCT STORED: PUL	TANK CAPACITY: 2000			
TB	FILL	1011	872			PASS
TB	TM	998	875			PASS
TB	STP	1007	891			PASS
TANK NO:		PRODUCT STORED:	TANK CAPACITY:			
TANK NO:		PRODUCT STORED:	TANK CAPACITY:			
TANK NO:		PRODUCT STORED:	TANK CAPACITY:			
TANK NO:		PRODUCT STORED:	TANK CAPACITY:			
TANK NO:		PRODUCT STORED:	TANK CAPACITY:			
TANK NO:		PRODUCT STORED:	TANK CAPACITY:			

NOTES:


ADAM WILDER
CERTIFIED TECHNICIAN NAME (printed)


CERTIFIED TECHNICIAN SIGNATURE
CERT NO: UC112310
EXPIRATION DATE: 8/8/2026


SITE DIAGRAM



Extra Photos

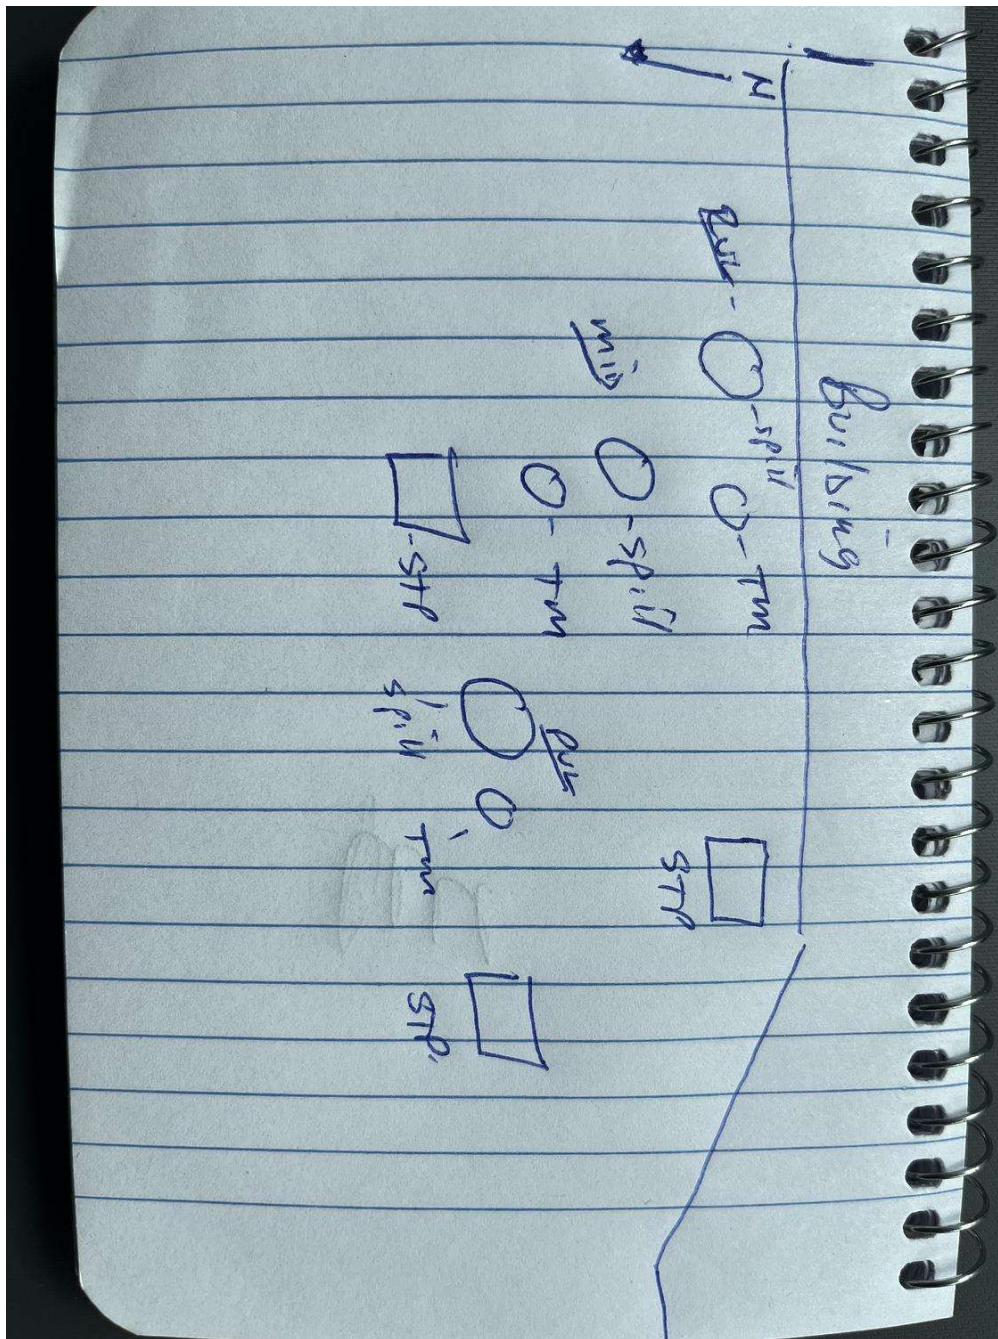

Site Layout .jpeg

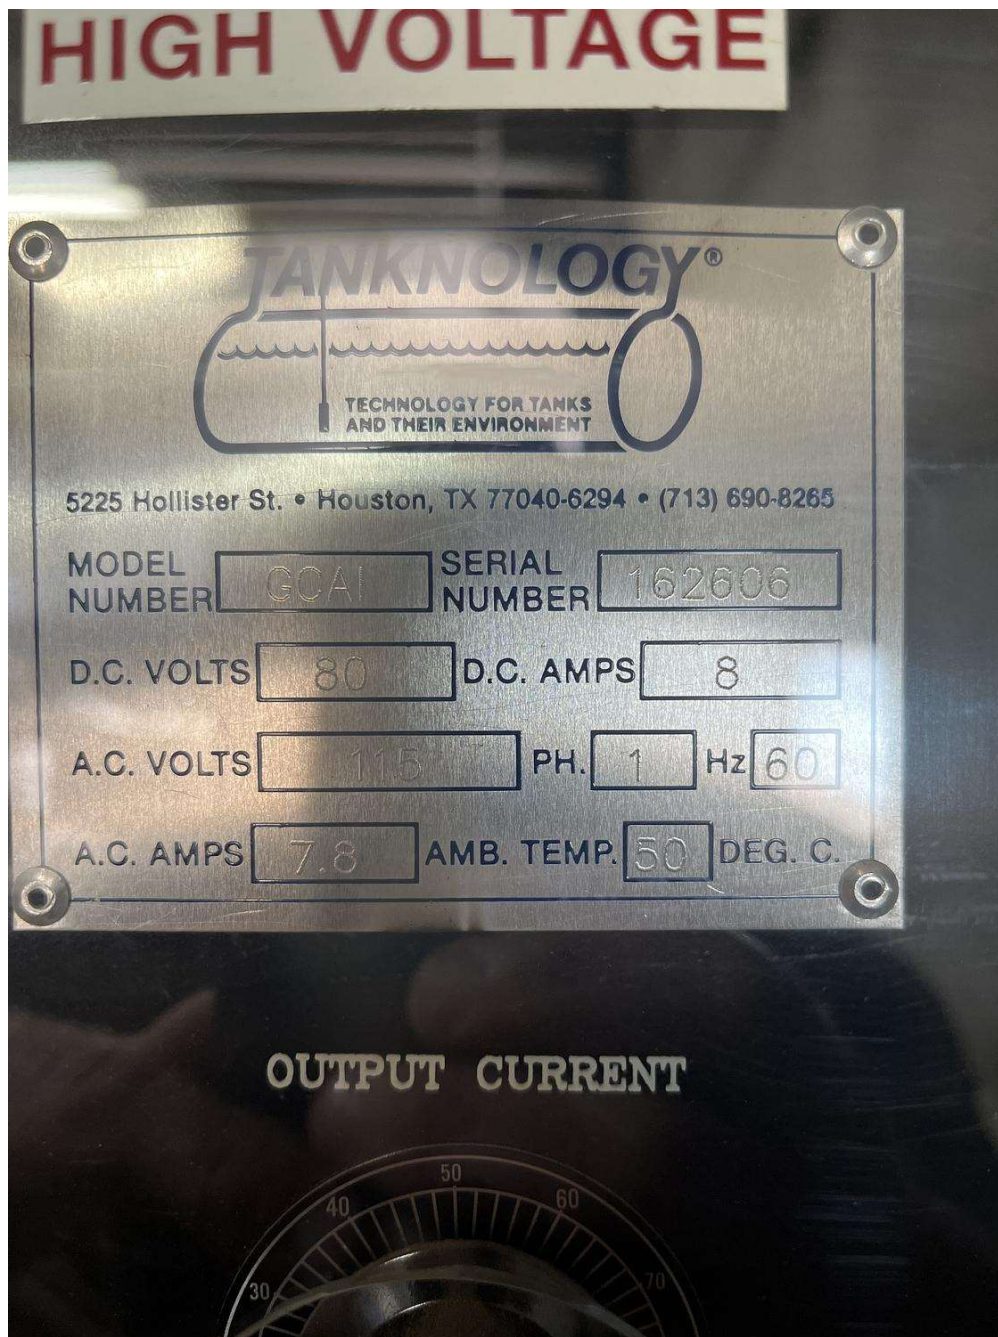

Rectifier.jpeg