



CERTIFICATION VERIFICATION



August 5, 2024


TanksData LLC
Muncie Southside Shell
1401 E 29th Street

Testing Date: 8/5/2024
Muncie Southside Shell
Location of Test: 1401 E 29th Street
Muncie, IN 47302
Site FID#: 02255
Service Technician: 0
Certified Technician: JOHN LANNOM

Midwest ECS has completed the following tests/inspections at the above noted location:

Cathodic Protection - sacrificial	X
Cathodic Protection - impressed current	

I, JOHN LANNOM, the certified technician, was present throughout the duration of the testing and/or inspection performed by Midwest ECS at the above address on the above date. I affirm that the testing was done in accordance with Rule 329 IAC 9 and 40CFR Part 80, is accurate based upon the results received and that these forms accurately reflect the results of the testing and/or inspection.

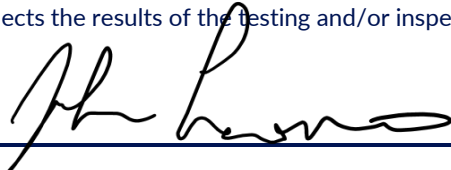Technician Signature: 

Technician Printed Name: JOHN LANNOM

Date & Time: 8/5/2024



INDIANA HOMELAND SECURITY

Underground Storage Tank

JOHN FRANCIS LANNOM
4400
W CR 350 S
MUNCIE, INDIANA



STATE/PERMIT #	ISSUE	EFFECTIVE	EXPIRATION
UC20129333C	08/31/2020	08/24/2022	08/17/2024

DISCIPLINES

- | | |
|---|--|
| ☐ Installation or Retrofitting | ☐ Decommissioning Closure |
| ☒ Cathodic Protection | ☐ Decommissioning Removal |
| ☒ Testing | |



CATHODIC PROTECTION



TEST DATE: 8/5/2024
LOCATION NAME: Muncie Southside Shell
LOCATION ADDRESS: 1401 E 29th Street
LOCATION CITY/STATE: Muncie, IN 47302
LOCATION PHONE: 317-645-0215
LOCATION CONTACT: Virendar Kumar


OWNER NAME: TanksData LLC
OWNER ADDRESS: Muncie Southside Shell
OWNER CITY/STATE/ZIP: 1401 E 29th Street
LOCATION FID#: 02255
WORK ORDER NO: NE-1248

SYSTEM TYPE: GALVANIC
TEMPERATURE: 88F
CONDITIONS: DRY
TIME: 10:30A

TANK NO		1	2	3	4		
PRODUCT STORED		UNL	UNL	PREM	AUTO DSL		
TANK CAPACITY		6000	6000	6000	5000		
TANK SIZE		96	96	96	96		
TANK CONTACT		TB	TB	TB	TB		
REFERENCE CELL LOCATION	LOCAL	TM	TM	TM	TM		
VOLTAGE READING		-903	-884	-889	-950		
REFERENCE CELL LOCATION	LOCAL	STP	STP	STP	STP		
VOLTAGE READING		-907	-894	-901	-961		
REMOTE VOLTAGE		-933	-957	-980	-982		
RESULT		PASS	PASS	PASS	PASS		

LEGEND	
TW	TEST WIRE
TB	TANK BOTTOM
TM	TANK MONITORING PROBE OPENING
INT	INTERSTITIAL OPENING

SITE DIAGRAM

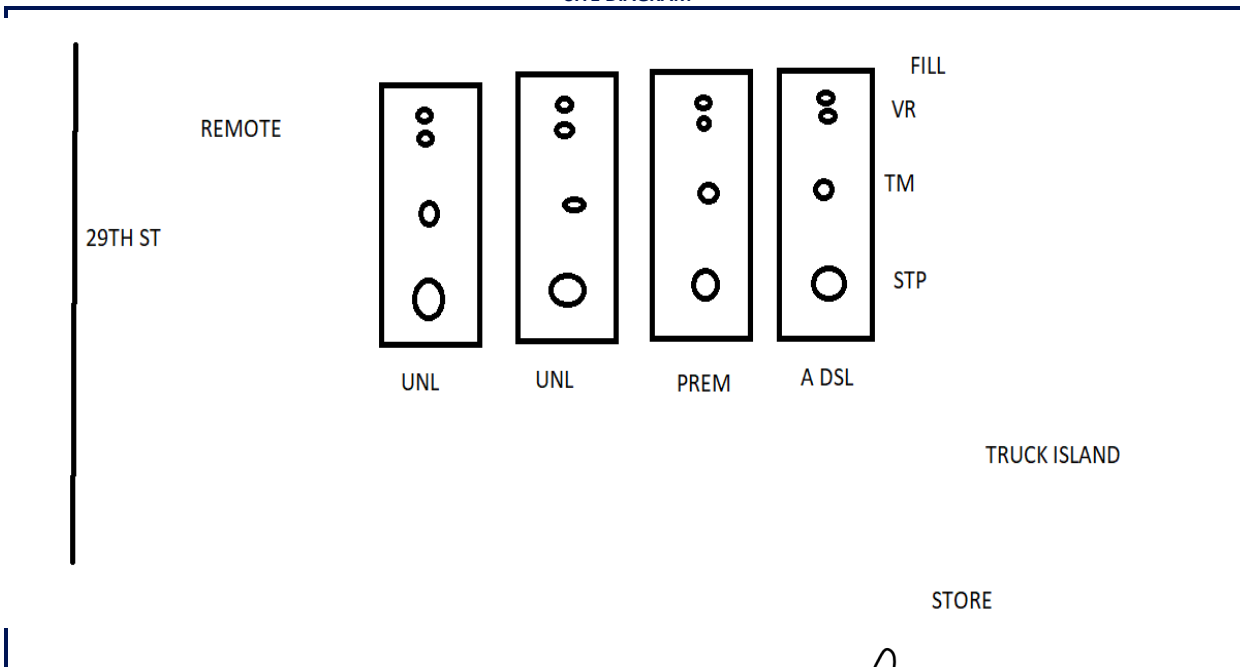

JOHN LANNOM
CERTIFIED TECHNICIAN NAME
(printed)

CERTIFIED TECHNICIAN SIGNATURE

CERT NO: UC20129333
EXPIRATION DATE: 8/17/2024