



Custom Tank Services
17437 Carey Road Box 163
Westfield, IN, 46074

Prepared By
John Lannom

Facility Details
Tanks Data
00249 JLG 2 Food Mart 00249
870 S State Street
North Vernon, IN 47265

State ID#: 00249

Custom Tank Services - Cathodic Protection - Galvanic

Completed October 7, 2025

Owner Details	Facility Details
Tanks Data 5296 Breakers Way Carmel, IN 46033	00249 JLG 2 Food Mart 00249 Main System 870 S State Street North Vernon, IN, 47265 State ID#: 00249
Inspection/Testing Result	
PASS	



CATHODIC PROTECTION



TEST DATE: 10-07-2025
LOCATION NAME: 00249 JLG 2 Food Mart 00249
LOCATION ADDRESS: 870 S State Street
LOCATION CITY/STATE: North Vernon, IN 47265
LOCATION PHONE:
LOCATION CONTACT:

OWNER NAME: Tanks Data
OWNER ADDRESS: 5296 Breakers Way
OWNER CITY/STATE/ZIP: Carmel, IN 46033

LOCATION FID#: 00249
WORK ORDER NO: 292219

SYSTEM TYPE: GALVANIC
TEMPERATURE: 72f
CONDITIONS: WET
TIME: 11:00a

TANK NO	1	2	3	4		
PRODUCT STORED	UNL	PREM	DSL	KERO		
TANK CAPACITY	12000	10000	10000	6000		
TANK SIZE	96	96	96	96		
TANK CONTACT	TW	TW	TW	TW		
REFERENCE CELL LOCATION	TM	TM	TM	TM		
VOLTAGE READING	-1181	-1023	-963	-904		
REFERENCE CELL LOCATION	STP	STP	STP	STP		
VOLTAGE READING	-1148	-975	-899	-886		
REMOTE VOLTAGE	-1044	-952	-927	-859		
RESULT	PASS	PASS	PASS	PASS		

PIPING LINE						
PRODUCT						
PIPING CONTACT						
REFERENCE CELL LOCATION						
VOLTAGE READING						
REFERENCE CELL LOCATION						
VOLTAGE READING						
REMOTE VOLTAGE						
RESULT						

LEGEND	
TW	TEST WIRE
TB	TANK BOTTOM
TM	TANK MONITORING PROBE OPENING
INT	INTERSTITIAL OPENING
STP	SUBMERSIBLE TURBINE PUMP
VR	VAPOR RECOVERY

NOTES:

John Lannom
CERTIFIED TECHNICIAN NAME

John Lannom
CERTIFIED TECHNICIAN SIGNATURE

CERT NO: UC2012933
EXPIRATION DATE: 08/09/2026



CERTIFICATION VERIFICATION

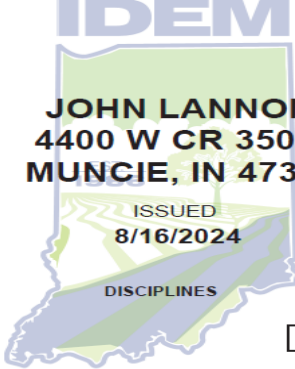


I, JOHN LANNOM, the certified technician, was present throughout the duration of the testing and/or inspection performed by Midwest ECS at the above address on the above date. I affirm that the testing was done in accordance with Rule 329 IAC 9 and 40CFR Part 80, is accurate based upon the results received and that these forms accurately reflects the results of the testing and/or inspection.

Technician Signature: _____

Technician Printed Name: _____

JOHN LANNOM

INDIANA DEPARTMENT OF ENVIRONMENTAL MANAGEMENT		
Underground Storage Tank		
		
JOHN LANNOM 4400 W CR 350 S MUNCIE, IN 47302		
STATE/PERMIT# UC20129333	ISSUED 8/16/2024	EFFECTIVE 8/16/2024
DISCIPLINES		
☐ Installation or Retrofitting Expiration Date:	☐ Decommissioning Expiration Date:	
☒ Cathodic Protection Expiration Date: 8/9/2026	☐ Tank Tightness Testing Expiration Date:	